




TYPICAL TRENCH
(except Under Pavement)
PVC FORCE MAIN SEWER PIPE
PVC WATER PIPE
Not To Scale
0103.DWG

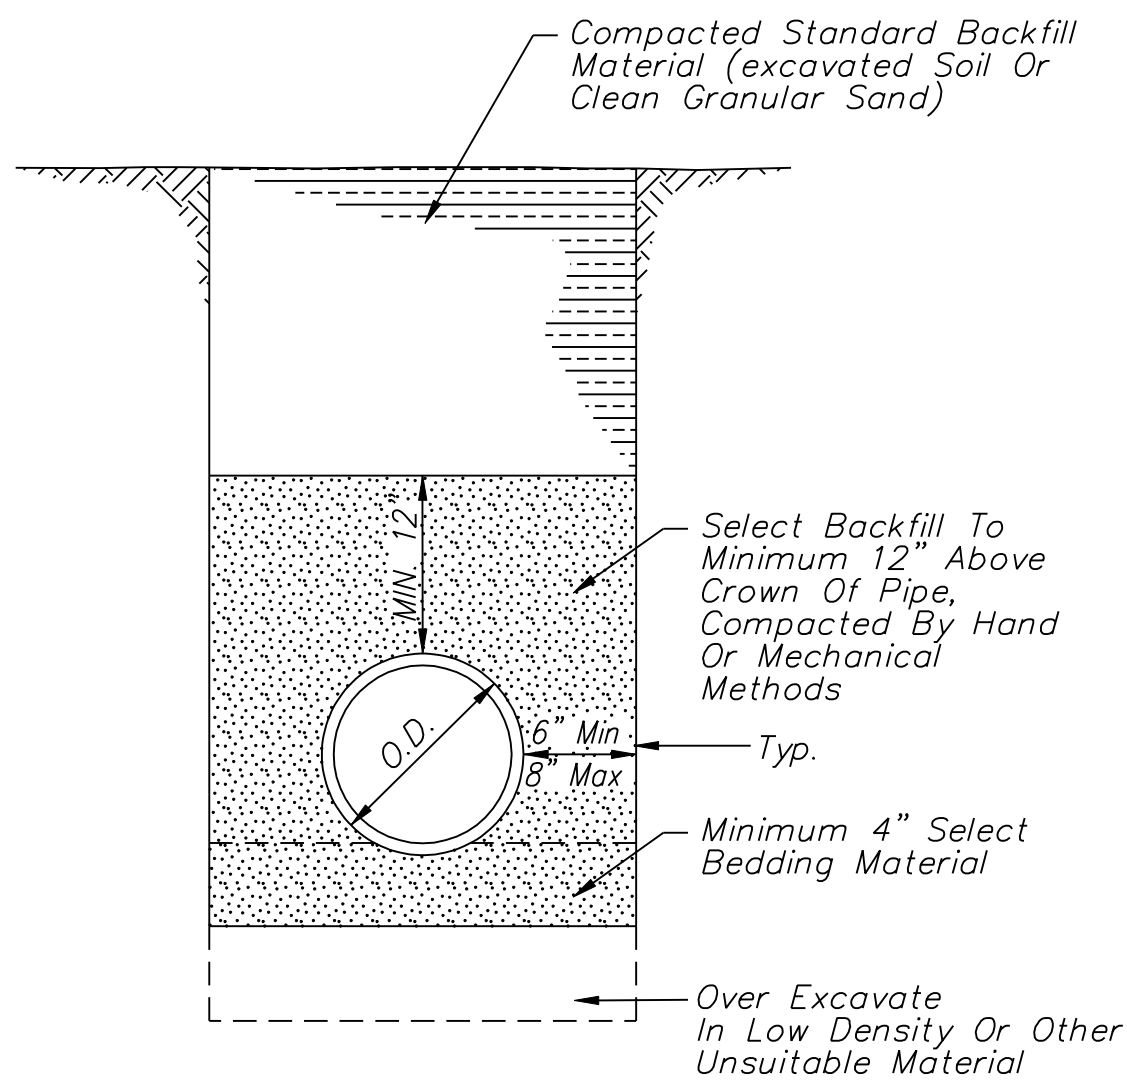


TYPICAL TRENCH
(except Under Pavement)
PVC GRAVITY SEWER PIPE
Not To Scale

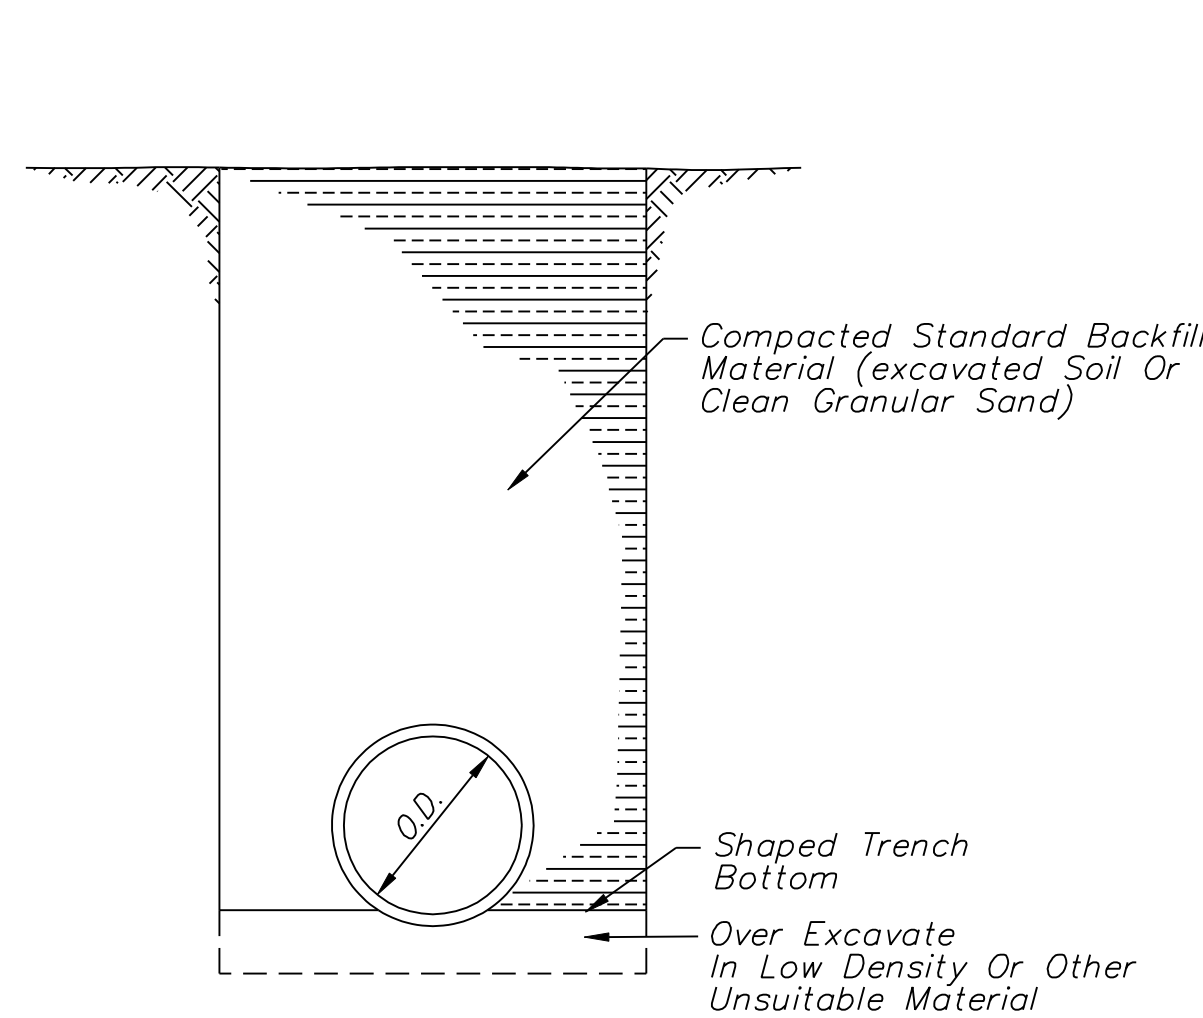



TYPICAL TRENCH
(except Under Pavement)
VITRIFIED CLAY GRAVITY SEWER PIPE
DUCTILE IRON WATER PIPE
DUCTILE IRON SEWER PIPE
Not To Scale
0107.DWG

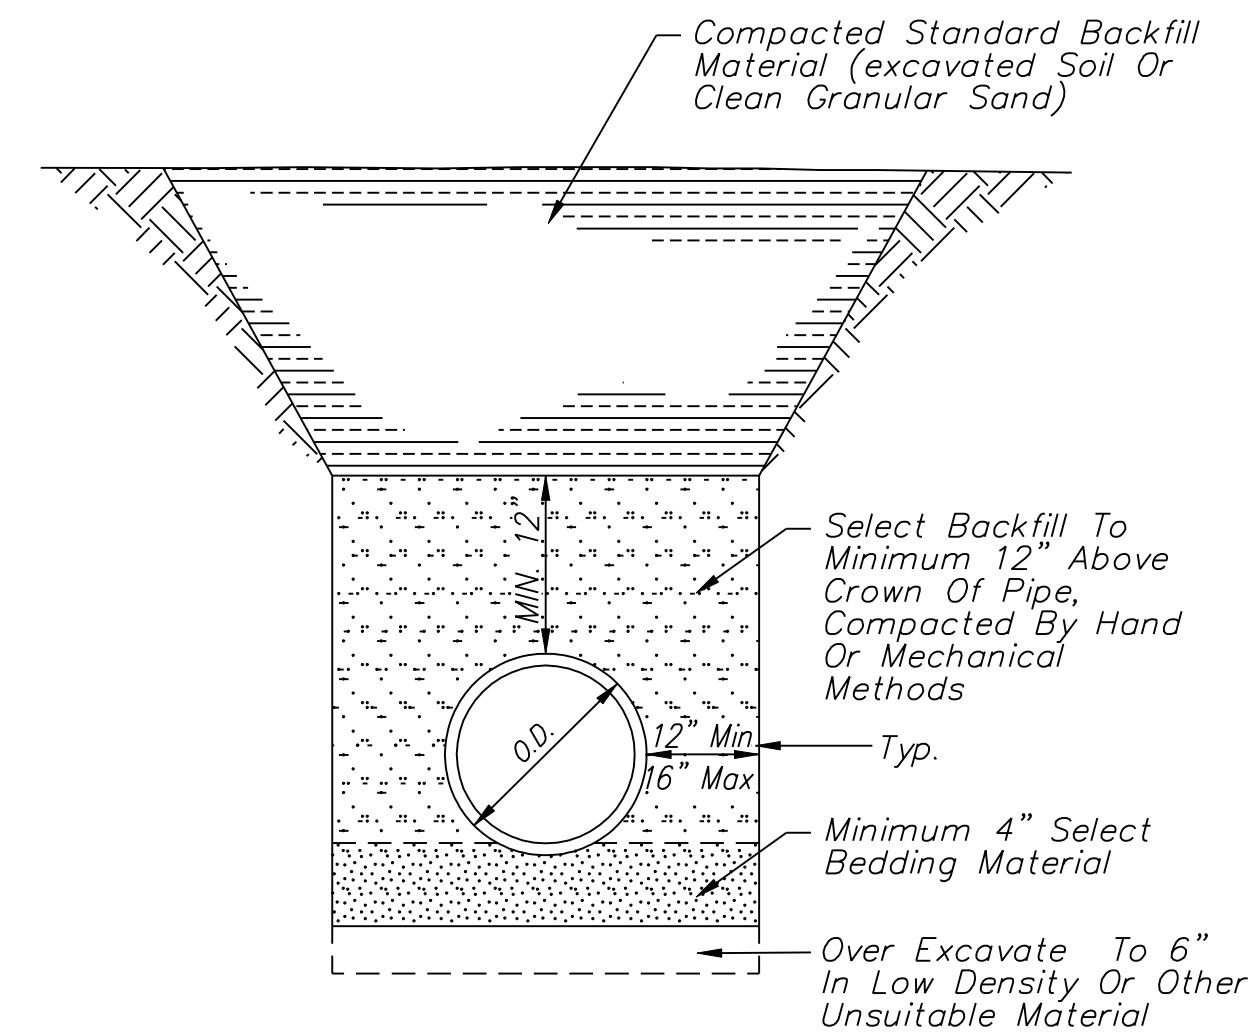


TYPICAL TRENCH OVER 20' IN TOTAL DEPTH
(except Under Pavement)
VITRIFIED CLAY GRAVITY SEWER PIPE
Not To Scale
0108.DWG

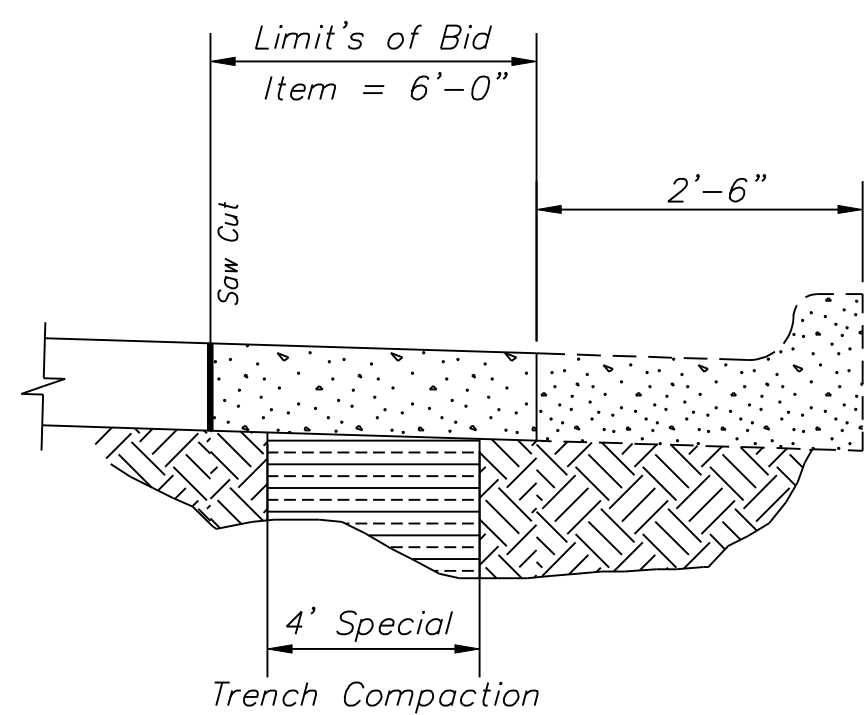


CONCRETE PAVEMENT REMOVAL DETAIL
CUSTOMER'S DRIVE REMOVAL DETAIL

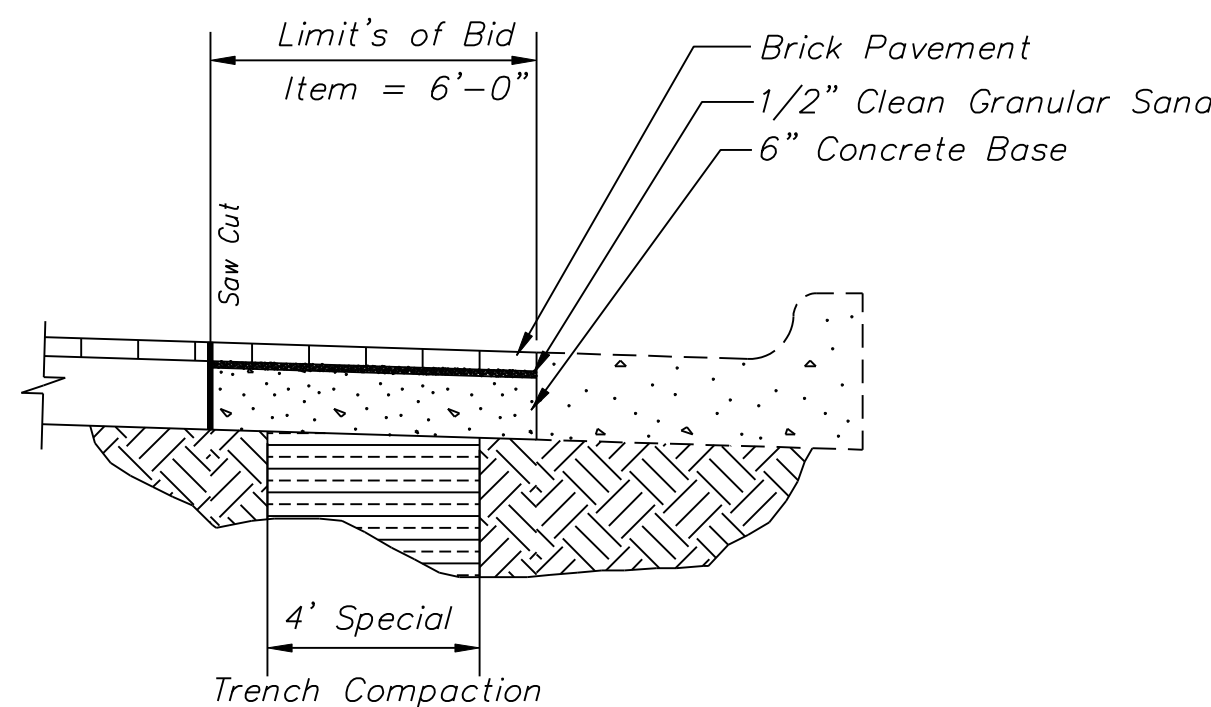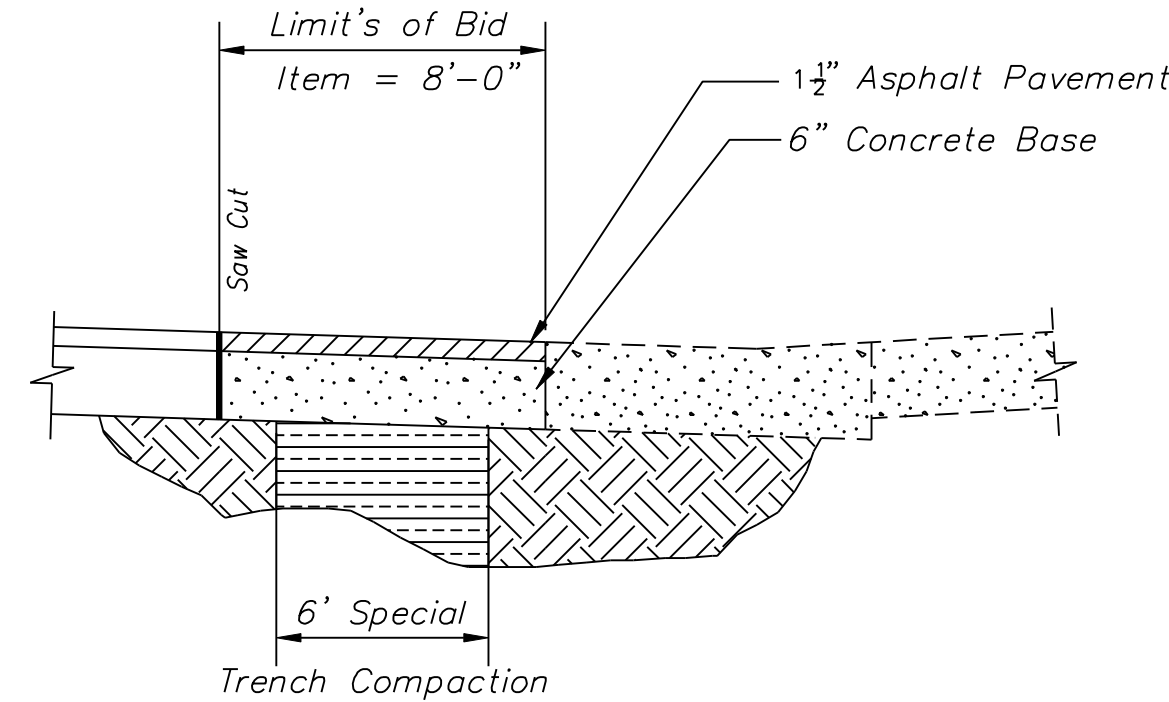

BRICK PAVEMENT REMOVAL DETAIL

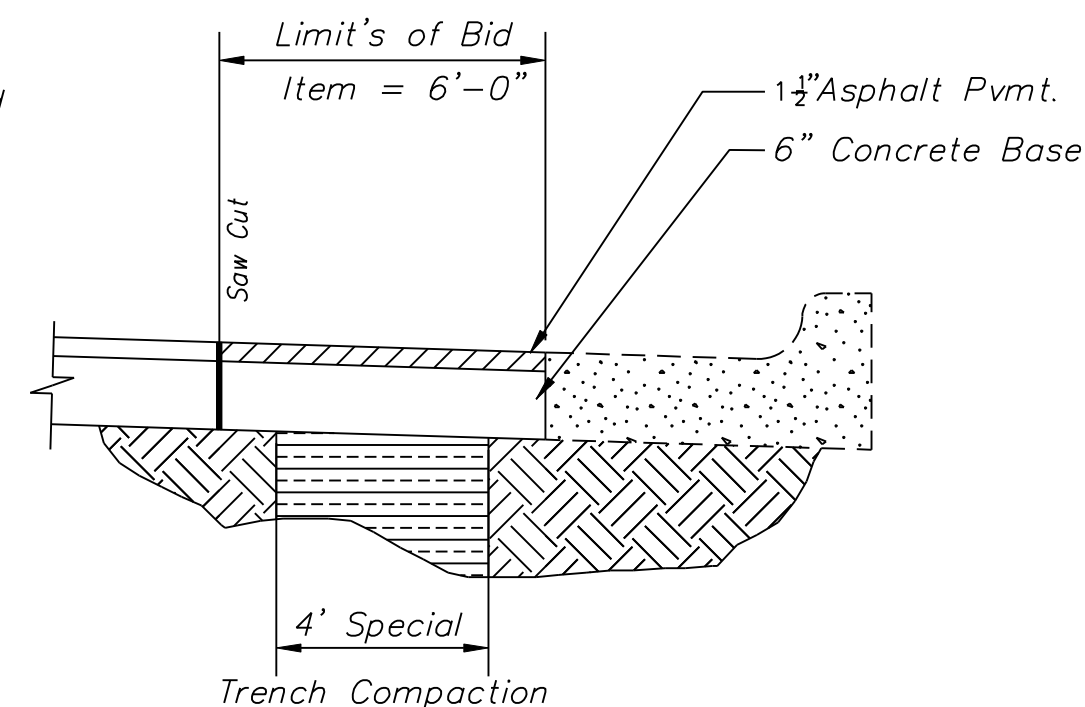

ASPHALT PAVEMENT REMOVAL DETAIL

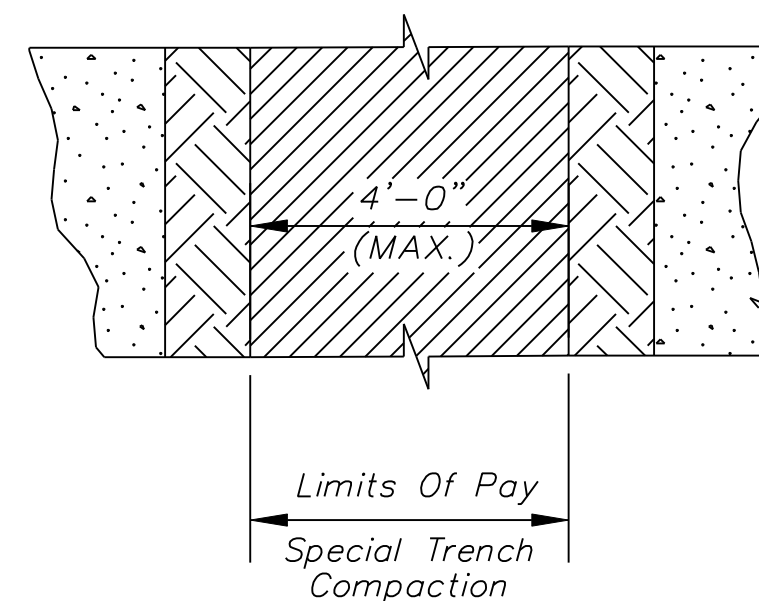

SPECIAL TRENCH COMPACTION DETAILS

UTILITY PATCH DETAILS
Not To Scale

Note: All structures within roadway shall be backfilled with non-excavatable flowable fill mix, 95%.

NO.	REVISIONS	DATE	BY

PROJECT TITLE:

STANDARD DETAILS—
MISCELLANEOUS UTILITIES DETAILS

CITY OF SALINA Dept. of Public Works Engineering Division 300 WEST ASH SALINA, KANSAS 67401 PH: 785.309.5725 FAX: 785.309.5713
--

DESIGN:	DATE:	PROJ. NO.:	SCALE:
DRAWN:	FILENAME:	SHEET:	OF: